

**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

Physical Data

| Model | NDW | | | |
|--------------------------------|-----------|-----------|-----------|-----------|
| | 100 | 120 | 150 | 180 |
| Compressor (2 each) | Scroll | | | |
| Factory Charge R410A, oz [kg] | 62 [1.76] | 62 [1.76] | 62 [1.76] | 62 [1.76] |
| Load Water Connection | | | | |
| FPT - in | 2 | 2 | 2 | 2 |
| Source Water Connection | | | | |
| FPT - in | 2 | 2 | 2 | 2 |
| Weight - Operating, lb [kg] | 390 [177] | 400 [181] | 400 [181] | 420 [190] |
| Weight - Packaged, lb [kg] | 385 [175] | 395 [179] | 395 [179] | 415 [188] |

3/9/09

Electrical Data

| Model | Supply Circuit | Rated Voltage | Voltage Min/Max | Compressor* | | | | Load Pump FLA | Source Pump FLA | Total Unit FLA | Min Circ Amp | Max Fuse/HACR |
|-------|----------------|---------------|-----------------|-------------|------|-------|-------|---------------|-----------------|----------------|--------------|---------------|
| | | | | MCC | RLA | LRA | LRA** | | | | | |
| 100 | L1/L2 | 208-230/60/1 | 187/253 | 41.2 | 26.4 | 134.0 | 47.0 | - | - | 26.4 | 33.0 | 50 |
| | L3/L4 | 208-230/60/1 | 187/253 | 41.2 | 26.4 | 134.0 | 47.0 | 4.2 | 4.2 | 34.8 | 41.4 | 60 |
| | Single | 208-230/60/3 | 187/253 | 24.9 | 16.0 | 110.0 | - | - | - | 32.0 | 36.0 | 50 |
| | Single | 460/60/3 | 414/506 | 12.1 | 7.8 | 52.0 | - | - | - | 15.6 | 17.6 | 25 |
| | Single | 575/60/3 | 517/633 | 8.9 | 5.7 | 38.9 | - | - | - | 11.4 | 12.8 | 15 |
| 120 | L1/L2 | 208-230/60/1 | 187/253 | 47.0 | 30.1 | 145.0 | 51.0 | - | - | 30.1 | 37.6 | 60 |
| | L3/L4 | 208-230/60/1 | 187/253 | 47.0 | 30.1 | 145.0 | 51.0 | 4.2 | 4.2 | 38.5 | 46.0 | 70 |
| | Single | 208-230/60/3 | 187/253 | 28.0 | 17.3 | 120.0 | - | - | - | 34.6 | 38.9 | 50 |
| | Single | 460/60/3 | 414/506 | 15.0 | 9.6 | 70.0 | - | - | - | 19.2 | 21.6 | 30 |
| | Single | 575/60/3 | 517/633 | 12.5 | 8.0 | 53.0 | - | - | - | 16.0 | 18.0 | 25 |
| 150 | L1/L2 | 208-230/60/1 | 187/253 | 42.0 | 26.9 | 145.0 | 51.0 | - | - | 26.9 | 33.6 | 60 |
| | L3/L4 | 208-230/60/1 | 187/253 | 42.0 | 26.9 | 145.0 | 51.0 | 4.2 | 4.2 | 35.3 | 42.0 | 60 |
| | Single | 208-230/60/3 | 187/253 | 35.0 | 22.4 | 190.0 | - | - | - | 44.8 | 50.4 | 70 |
| | Single | 460/60/3 | 414/506 | 19.0 | 12.2 | 87.0 | - | - | - | 24.4 | 27.5 | 30 |
| | Single | 575/60/3 | 517/633 | 15.0 | 9.6 | 62.0 | - | - | - | 19.2 | 21.6 | 30 |
| 180 | L1/L2 | 208-230/60/1 | 187/253 | 50.0 | 32.1 | 185.0 | 65.0 | - | - | 32.1 | 40.1 | 70 |
| | L3/L4 | 208-230/60/1 | 187/253 | 50.0 | 32.1 | 185.0 | 65.0 | 4.2 | 4.2 | 40.5 | 48.5 | 80 |
| | Single | 208-230/60/3 | 187/253 | 39.0 | 26.0 | 190.0 | - | - | - | 52.0 | 58.5 | 80 |
| | Single | 460/60/3 | 414/506 | 19.0 | 13.0 | 100.0 | - | - | - | 26.0 | 29.3 | 40 |
| | Single | 575/60/3 | 517/633 | 14.5 | 9.3 | 72.0 | - | - | - | 18.6 | 20.9 | 30 |

7/22/09

HACR circuit breaker in USA only

* Ratings per each compressor - unit supplied with two

** With optional IntelliStart (single phase only)

WaterFurnace works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Please contact WaterFurnace at 1-888-929-2837 for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely WaterFurnace's opinion or commendation of its products. The latest version of this document is available at www.waterfurnace.com.

**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

Load and Source Pressure Drop

| Model | GPM | Pressure Drop (psi) | | | | |
|-------|-----|---------------------|------|------|------|-------|
| | | 30°F | 50°F | 70°F | 90°F | 110°F |
| 100 | 15 | 1.0 | 0.8 | 0.5 | 0.3 | 0.1 |
| | 23 | 2.5 | 2.2 | 2.0 | 1.7 | 1.3 |
| | 30 | 3.8 | 3.6 | 3.3 | 3.1 | 2.4 |
| | 34 | 4.5 | 4.3 | 4.0 | 3.8 | 3.0 |
| 120 | 18 | 1.6 | 1.3 | 1.1 | 0.8 | 0.6 |
| | 28 | 3.4 | 3.2 | 2.9 | 2.7 | 2.1 |
| | 36 | 4.9 | 4.7 | 4.4 | 4.2 | 3.3 |
| | 40 | 5.6 | 5.4 | 5.1 | 4.9 | 3.9 |
| 150 | 21 | 2.1 | 1.9 | 1.6 | 1.4 | 1.0 |
| | 32 | 4.2 | 3.9 | 3.7 | 3.4 | 2.7 |
| | 42 | 6.0 | 5.8 | 5.5 | 5.3 | 4.2 |
| | 50 | 7.5 | 7.3 | 7.0 | 6.8 | 5.5 |
| 180 | 24 | 2.7 | 2.4 | 2.2 | 1.9 | 1.5 |
| | 36 | 4.9 | 4.7 | 4.4 | 4.2 | 3.3 |
| | 48 | 7.1 | 6.9 | 6.6 | 6.4 | 5.1 |
| | 60 | 9.3 | 9.1 | 8.8 | 8.6 | 7.0 |

3/9/09

WaterFurnace works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Please contact WaterFurnace at 1-888-929-2837 for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely WaterFurnace's opinion or commendation of its products. The latest version of this document is available at www.waterfurnace.com.


**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Contractor: _____ P.O.: _____
 Engineer: _____
 Project Name: _____ Unit Tag: _____

Wiring Schematics

208-230/60/1

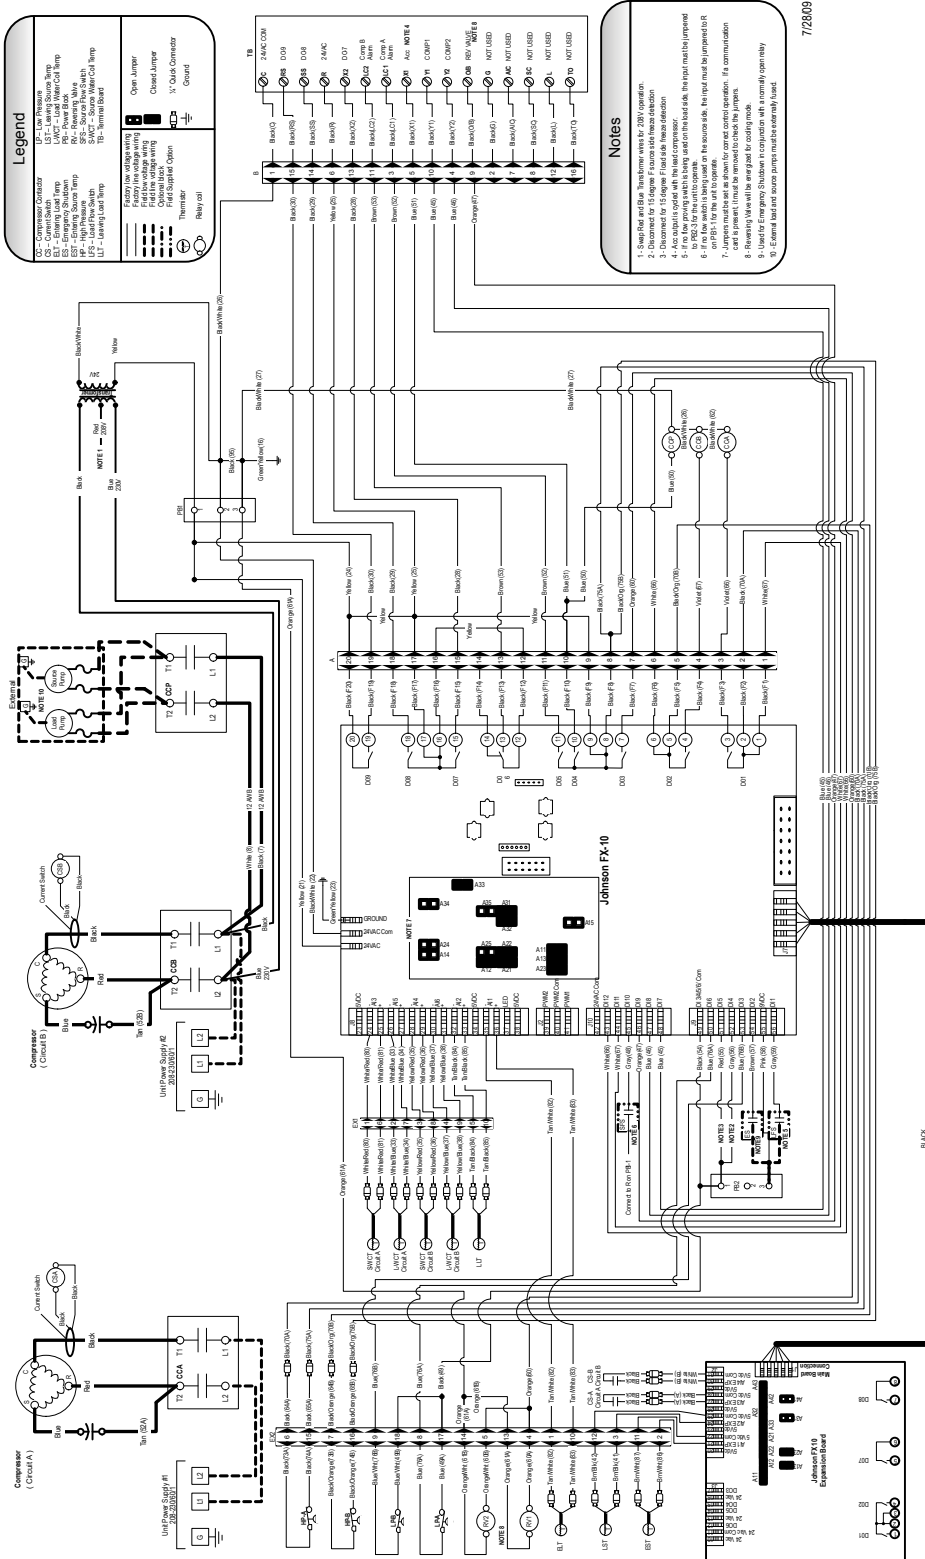

WaterFurnace works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Please contact WaterFurnace at 1-888-929-2837 for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely WaterFurnace's opinion or commendation of its products. The latest version of this document is available at www.waterfurnace.com.


**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Contractor: _____ P.O.: _____
 Engineer: _____
 Project Name: _____ Unit Tag: _____

Wiring Schematics cont.

460/60/3

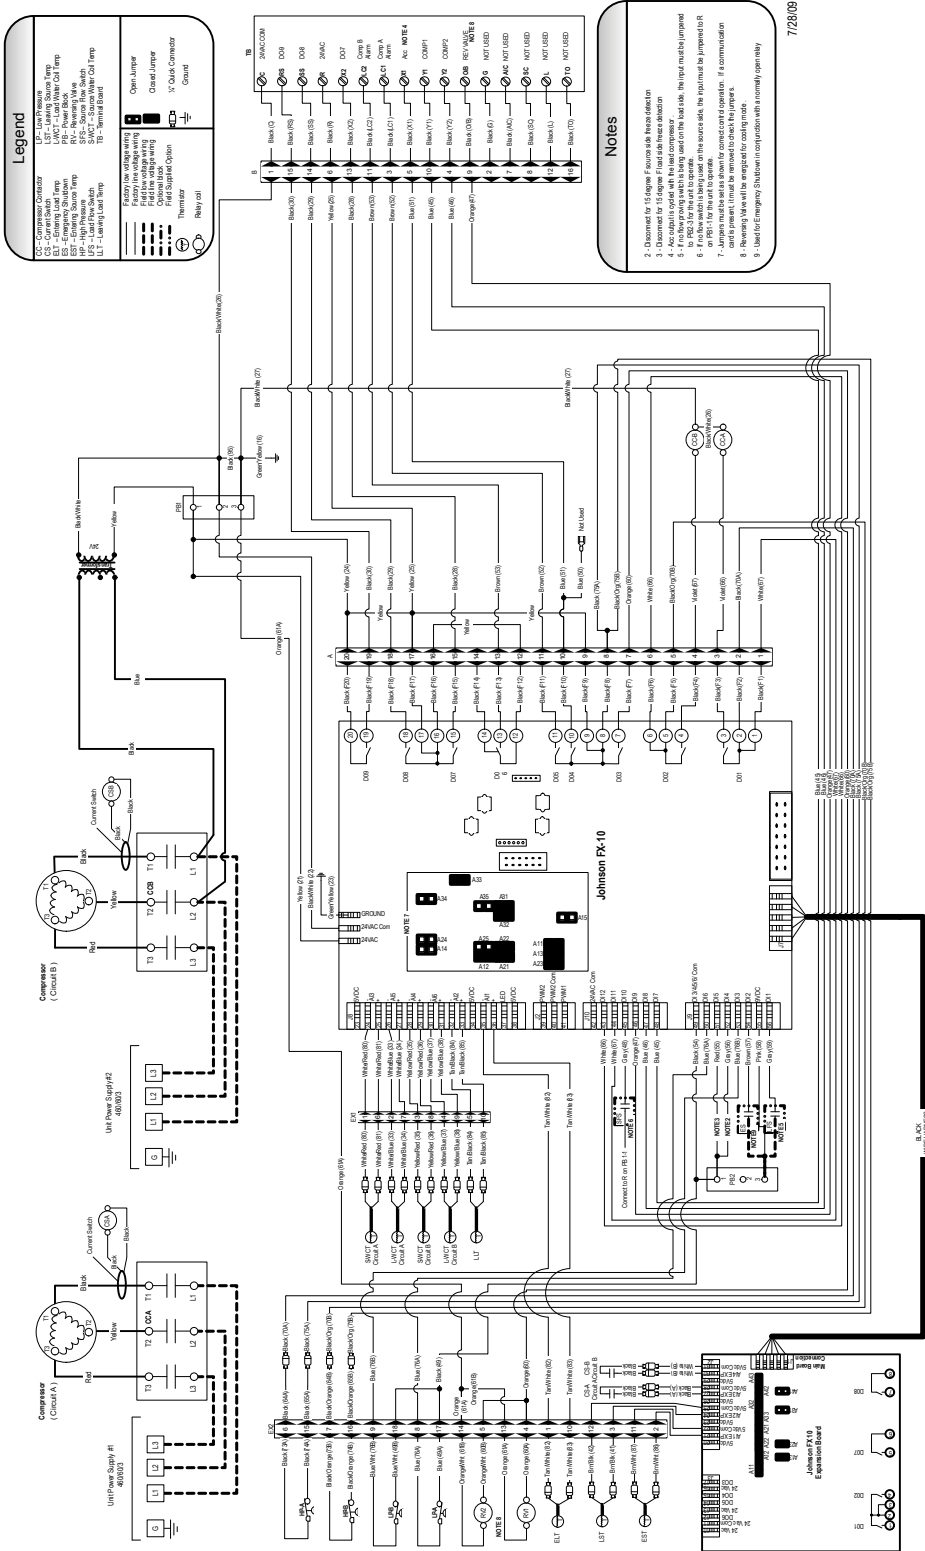

WaterFurnace works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Please contact WaterFurnace at 1-888-929-2837 for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely WaterFurnace's opinion or commendation of its products. The latest version of this document is available at www.waterfurnace.com.

Contractor: _____ P.O.: _____

Engineer: _____


Project Name: _____ Unit Tag: _____

**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Wiring Schematics cont.

MUI Wiring Diagram

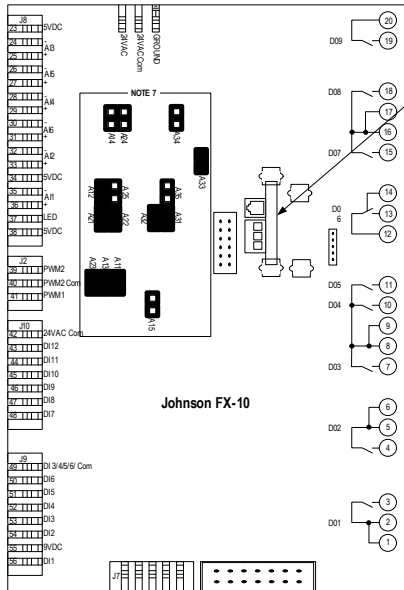


DLI Card

Instructions :

- 1.) Disconnect all power sources to the unit
- 2.) Remove MUI from Back Plate
- 3.) Follow Wiring Instruction Below
- 4.) Reinstall MUI to Back Plate

MUI Back Plate

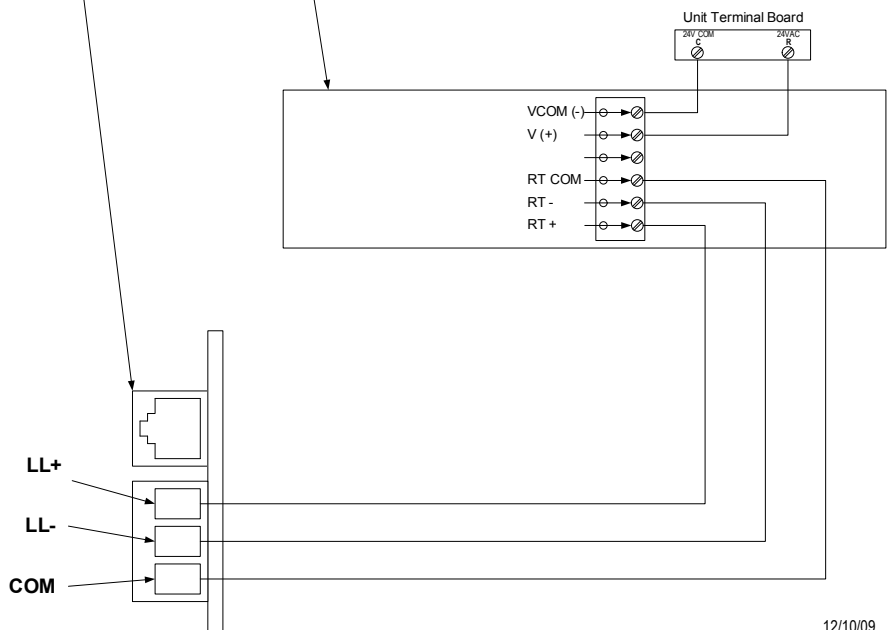

12/10/09

WaterFurnace works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Please contact WaterFurnace at 1-888-929-2837 for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely WaterFurnace's opinion or commendation of its products. The latest version of this document is available at www.waterfurnace.com.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

ENVISION SERIES NDW HYDRONIC 8 TO 15 TONS



Engineering Guide Specifications

General

The liquid source water-to-water heat pump shall be a single packaged reverse-cycle heating/cooling unit. The unit shall be listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory, Underwriters Laboratory (UL), or Canadian Standards Association (CSA). The unit shall be rated in accordance with Air Conditioning, Heating, and Refrigeration Institute/International Standards Organization (AHRI/ISO) and Canadian Standards Association (CSA-US). The liquid source water-to-water heat pump unit, as manufactured by WaterFurnace International, Fort Wayne, Indiana, shall be designed to operate with source liquid temperatures between 30°F [1.1°C] and 110°F [43.3°C] in cooling, and between 20°F [-6.7°C] and 90°F [32.2°C] in heating.

Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1,000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2" thick, multi-density, coated glass fiber for noise suppression.

The control box shall have separate holes and knockouts for entrance of line voltage and low voltage control wiring. All factory-installed wiring passing through factory knockouts and openings shall be protected from sheet metal edges at openings by plastic ferrules. The control box shall be field switchable from front to back for improved application flexibility with quick attach low voltage harnesses. The control box is shipped standard on the opposite end of the water connections.

Refrigerant Circuit

All units shall contain two (2) sealed refrigerant circuits, each containing a hermetic motor scroll compressor, bidirectional thermal expansion valve assemblies, reversing valve, braze plate heat exchangers, factory installed high and low pressure safety switches, freeze detection, service ports, and liquid line filter driers. Compressors shall be scroll types designed for heat pump duty with internal isolation and mounted on rubber vibration isolators. Compressor motors shall have internal overload protection. A high density sound attenuating blanket shall be factory installed around the compressor to reduce sound. The water to refrigerant heat exchangers shall be interlaced copper brazed, 316 stainless plate steel, capable of withstanding 650 psig [4489 kPa] working pressure on the refrigerant side and 450 psig [3108 kPa] on the water side.

The thermal expansion valve assembly shall provide proper superheat over the liquid temperature range with minimal "hunting." The assembly shall operate bidirectionally without the use of check valves. Externally mounted pressure controlled water regulating flow valves are not acceptable.

Piping and Connections

Supply and return water connections shall be 2 in. [50.8 mm] FPT copper fittings fixed to the cabinet by use of a captive fitting, which eliminates the need for backup pipe wrenches.

Optional Back/Top Mount Water Connections - shall be factory installed to the back corner post or top panel by use of a captive fitting, which eliminates the need for backup pipe wrenches.



WARNING: Warranty is void if strainers are not used on the entering side of the load and source.

Electrical

Controls and safety devices will be factory wired and mounted within the unit. Controls shall include 24 Volt activated compressor contactors, 24VAC-75VA transformer with built in circuit breaker, reversing valve coils, and anti short-cycle protection. A terminal block with screw in terminals will be provided for field control wiring. To prevent short cycling when the safety controls are activated, the reset relay shall provide a lockout circuit that requires resetting of low voltage supply or main circuit breaker. A lockout signal shall be provided to the display to indicate a lockout situation. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 Volt and provide heating or cooling as required by the remote thermostat/sensor.

Optional IntelliStart (Compressor Soft Starter) - shall be factory installed for use in applications that require low starting amps, reduced compressor start-up noise, off-grid, and improved start-up behavior. IntelliStart shall reduce normal starting current by 60% on 208/60/1 units.

Contractor: _____ P.O.: _____

Engineer: _____

Project Name: _____ Unit Tag: _____

**ENVISION SERIES NDW
HYDRONIC 8 TO 15 TONS**



Engineering Guide Specifications cont.

Microprocessor Control

The unit shall be controlled using an FX10 microprocessor which sequences all functions and modes of operations. The control shall interface with a (Y,B) thermostat, mechanical or electronic. The control shall have the ability to communicate with N2 Open, BacNet, or LonWorks protocols with optional communication card. The control system shall have the following features:

1. Anti-short cycle time delay on compressor operation, time delay shall be a minimum of 3 minutes
2. Random start on power up mode
3. Low voltage protection
4. High voltage protection
5. Unit shutdown on high or low refrigerant pressures
6. Unit shutdown for low water temperature
7. Source and Load heat exchanger low water temperature cutout selectable for water or anti-freeze
8. Automatic intelligent reset (Unit will automatically reset 5 minutes after trip if the fault has cleared. Should a fault reoccur 3 times sequentially then permanent lockout will occur.)
9. A 4 x 20 digit backlit LCD to display the following:
 - a. Entering and leaving water temperatures
 - b. High pressure, low pressure, low voltage, high voltage, low water temperature cutout, and control status
10. The low pressure shall not be monitored for the first 120 seconds after a compressor start command to prevent nuisance safety trips.
11. Remote fault indication on the thermostat
12. An accessory relay output tied to each compressor selectable for normally open or normally closed

Optional N2 Open, BacNet, or LonWorks - Units shall have all the features listed above and the control board will be supplied with a interface card of choice. This will permit all units to be daisy chain connected by a 2-wire twisted pair shielded cable. The following points must be available at a central or remote computer location:

1. Space temperature
2. Source leaving water temperature
3. Load leaving water temperature
4. Command of temperature setpoint
5. Cooling status
6. Heating status
7. Unoccupied/Occupied command
8. Compressor shutdown (load shedding) command
9. Emergency shutdown command
10. Cooling command
11. Heating command

Accessories

Flow Proving Switch

WaterFurnace P/N - FPS300

A flow proving switch shall be available utilizing high reliability flow sensing technology.

Strainer Connection Kit

WaterFurnace P/N - CKNDW1

A strainer connection kit shall be available and includes a 2 in. [50.8 mm] Y-strainer with self-aligning screen and 1 in. [25.4 mm] blow-off port to reduce debris that will enter the heat exchanger. Strainers should be made of a brass body with a 316 stainless steel screen. Connection kit shall also include a 2 in. [50.8 mm] wrought copper tee with integral pressure/temperature port.

Strainer Hose Kit Set

WaterFurnace P/N - HHK162S

A strainer hose kit set shall be available and includes a 2 in. strainer loaded with 20-40 mesh screen and blow down valve, 2 in. stainless steel braid hose, 2 in. ball valve with integral pressure/temperature port and a JIC swivel fitting on the supply and 2 in. stainless steel braid hose and 2 in. ball valve with integral pressure/temperature port and a JIC swivel fitting on the return hose. The hose kit assembly shall be pressure rated at 300 psi working pressure.

NOTE: A strainer kit is required on both sides to reduce heat exchanger fouling and potential damage.